

## Proportional pressure reducing valve Types DRE and DREM

RE 24750/06.2004

Size 10.25.32

up to 31.5 MPa

up to 300 L/min

Replaces:

#### Features:

- Optional max.pressure protecting
- Optional check valve between A and B
- Valve used for reducing a working pressure
- For subplate mounting
- Valve and electronics from one scurce



#### Function, section

The valve types DRE and DREM are pilot operated pressure reducing valves. They are used for the reduction of a working pressure.

The valves basically consist of the pilot valve (1) with proportional solenoid (2), main valve (3) with main spool assembly (4), as well as an optional check valve (5).

#### Type DRE...

The setting of the pressure in port A is dependent on the voltage present at the proportional solenoids (2).

At rest, with no pressure in port B the spring holds the main spool (4) in its start position. The connection from B to A is closed. A start-up jump is, therefore avoided.

The pressure in port A acts via connection on the area of the main spool.

The pilot oil is taken from port A(NS 10) or port B(NS 20,30) and passes through the connection to the constant flow controller, which holds the pilot oil flow constant independent of pressure drops between ports A and B. From the constant


flow controller the pilot oil flow passes into the spring chamber, through two connections, via valve seat into the Y port and from there into the drain line.


The pressure required in port A is defined at the relevant amplifier.

#### Type DREM...

In order to ensure that excessive hydraulic pressures (hydraulic safety) do not occur due to unpermissibly high control currents at the proportional solenoid that automatically cause higher pressure in port A, a spring loaded maximum pressure relief valve, for maximum pressure safety, can be optionally installed if required.

Note: When the pressure fluid flow from port A to port B via the check valve (5), the parallel flow of oil via Y to tank affects the deceleration process of the actuator attached to port A if this is being decelerated by a throttle valve in port B (e.g. proportional directional valve). Under such circumstances, the third flow direction A to Y is not suitable for limiting the maximum pressure in port A.

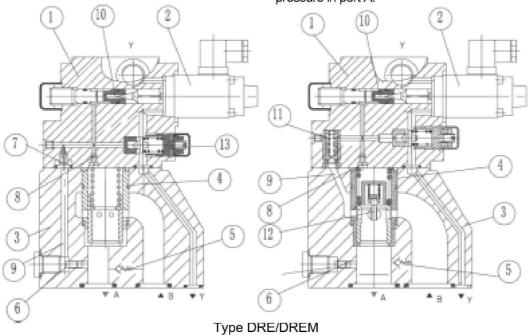

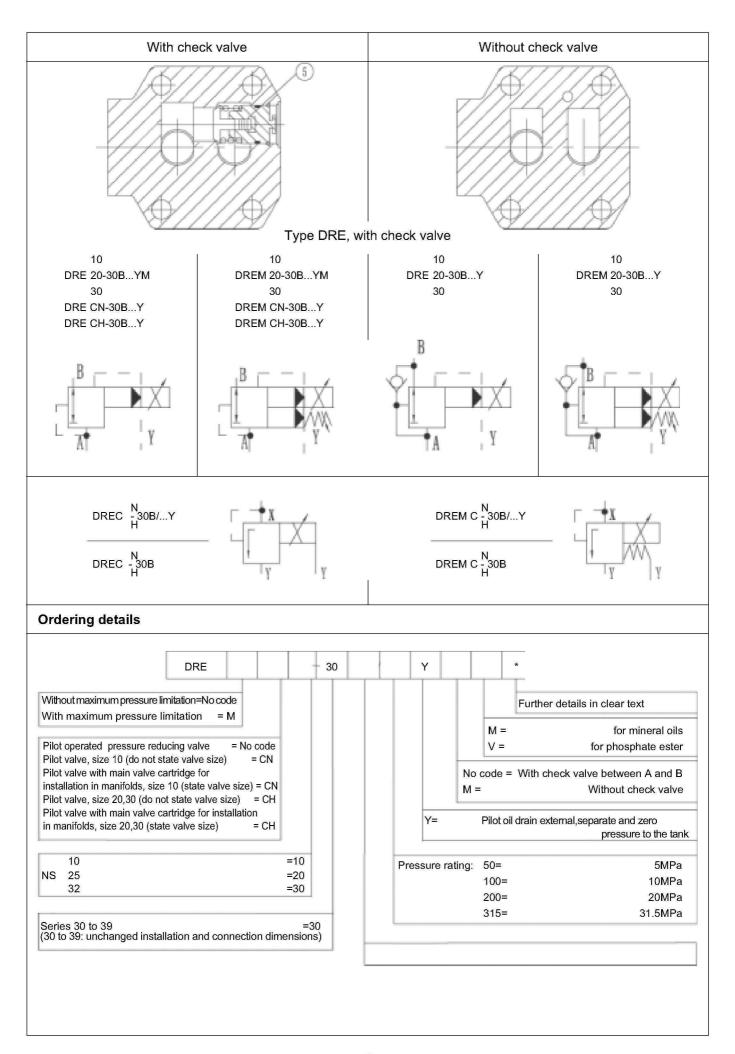

#### Technical data

#### Hydraulic


Max.setting pressure (MPa)	ports A and B	31.5						
max.setting prossure (iiii a)	port Y	go to tank ,no pressure						
Max.setting pressure,for port A	(MPa)	(MPa) The same as pressure rating						
Min.setting pressure,for port A	(MPa)	Be related to "Q". (see curves)						
Max.pressure limiter (steplessly settable)								
			pressu	re rating				
Setting pressure range set as delivered	(MPa)	5	10	20	31.5			
		1 to 6+2	1 to 12+2	1 to 22+2	<sup>2</sup> 1 to 34* <sup>2</sup>			
Max.pressure limiter (assembly settable)	(MPa)	6 to 8	12 to 14	22 to 24	34 to 36			
Max. flow (L/min) —	size	10 2		20	30			
Max. now (L/min) ———	flow	80	2	200				
Pilot oil			See charact	teristic curves				
Linearity	(%)	± 3.5						
Repeatability	(%)		<	± 2				
Hysteresis		With qui	ver $\pm$ 2.5%Pmax,	without quiver $\pm$	4.5%Pmax			
Typical scatter		±	2.5Pmax See	characteristic c	urves			
Operating time	(ms)		100	to 300				
Fluids		Mineral o	il(for NBR seal),Pl	nosphate ester (	for FPM seal)			
Viscosity range	(mm²/s)		2.81	to 380				
Fluid temperature range	(°C)		-20 1	to +70				
Degree of the contamination	(μm)		≤ 20(reco	mmend 10)				


#### Electrical


Supply voltage		DC
Min.control current	(A)	0.1
Max.control current	(A)	0.8
Coil resistance	(Ω)	cold valve at 20°C is 19.5,Max.warm valve is 28.8
Duty		continuous
Max. condition temperature	(°C)	+50
Insulation to DIN 40 050		IP65
Associated amplifier		Plug-in connecter
Electrical applifier		VT-2000 s 40(together provide)

### Characteristic curves (measured at V = 41 mm<sup>2</sup>/s and t= 50°C)


#### Pressure difference from A to B,via check valve

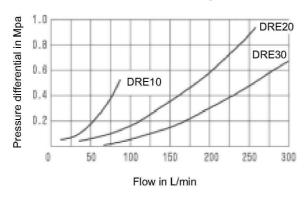

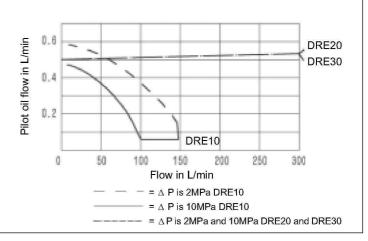

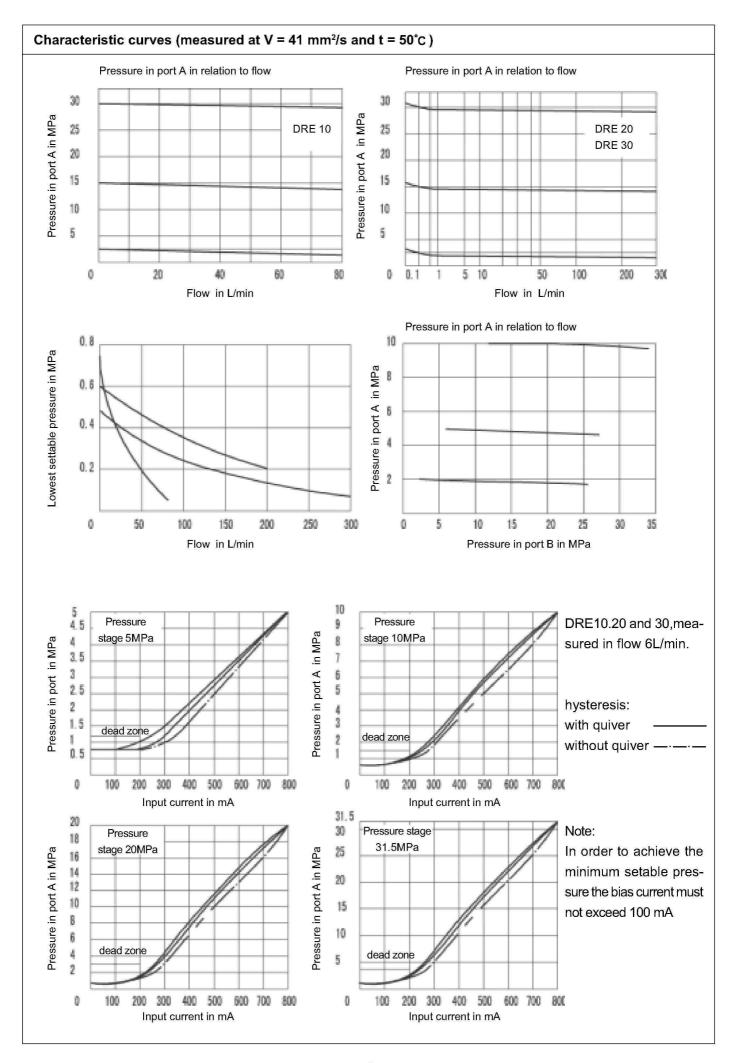

#### **Unit dimensions** (Dimensions in mm)

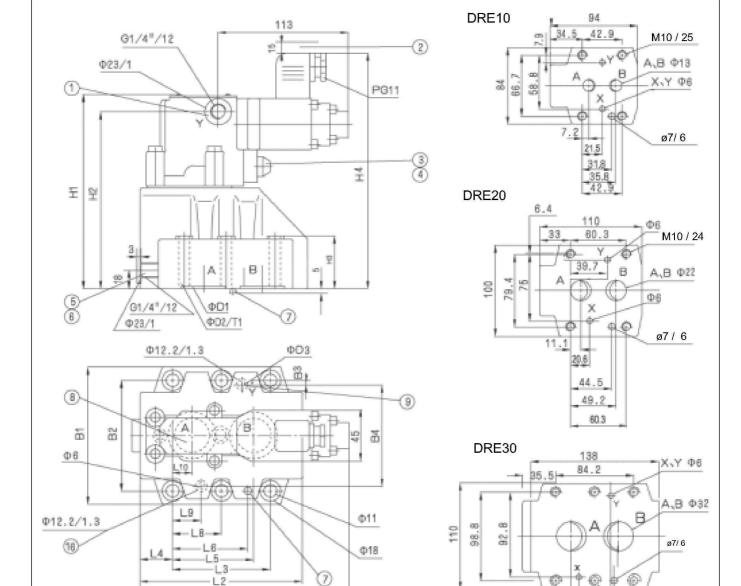

- 1 As supplied, this port (G 1/4") is plugged. 5 Port X for external control After removing the plug, this port may be used 6 Pressure gauge connecter for DRE20 and DRE30 as an external pilot oil drain, separate and at 7 Locating pin zero pressure to tank.
- 3 Maximum pressure limitation, type DREM
- 4 when using these valves, please take note of the guidelines

- 8 Name plate
- 2 Space required to remove plug-in connector 9 Pilot oil drain external at zero pressure to tank
  - 10 Blind hole

İ	NS	O-ring (A B)	O-ring (X, Y)	B1	B2	В3	В4	D1	D2	D3
	10	17.12 × 2.62	9.25 × 1.78	85	66.7	7.9	58.8	15	21.8	4.2
	25	28.17 × 3.53	9.25 × 1.78	102	79.4	6.4	73	25	34.8	6
	32	34.52 × 3.53	9.25 × 1.78	120	96.8	3.8	92.8	31	41	6

Subplates G 460/01; G461/01 G 412/01; G413/01 G 414/01; G415/01 valve fixing screws 6 M10 x 70 DIN 912-10.9, MA = 75 Nm See page 88

M10 / 25

16.7


-59.5

62.7

-67.5

size	H1	H2	НЗ	H4	L1	L2	L3	L4	L5	L6	L7	L8	L9	L10	T1	Weight
10	152	136.5	28	188	181	96	42.9	35.5	35.8	31.8	21.5	a <del>-</del>	21.5	7.2	2	4.5kg
25	162	146.5	38	198	177	112	60.3	33.5	49.2	44.5	39.7	2 <b>-</b>	20.6	11.1	2.9	6.3kg
32	170	154.5	46	206	176.5	140	84.2	28	67.5	62.7	59.5	42.1	24.6	16.7	2.9	8.6kg

Unit dimensions (Dimensions in mm)

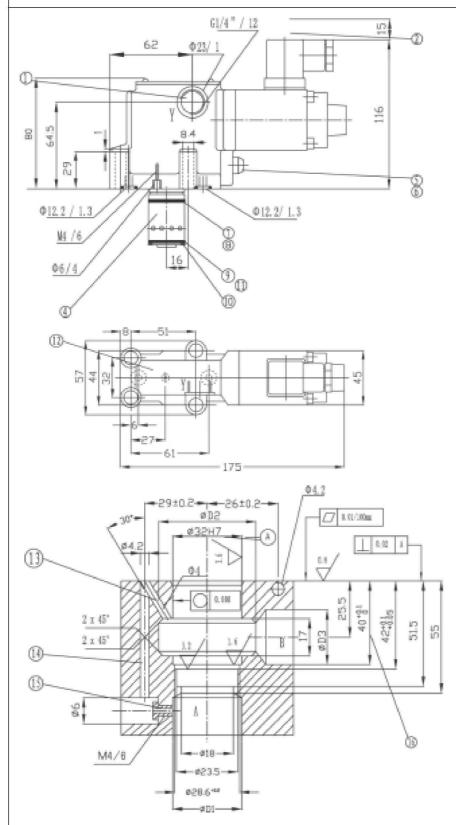

- 1 Pilot oil drain external at zero pressure to tank
- 2 Space required to remove plug-in connector
- 3 O-ring 9.25X1.78
- 4 Main spool core assembly
- 5 Maximum pressure limitation, type DREM
- 6 When using these valves, please take note of the guidelines
- 7 O-ring 9.25X1.78
- 8 O-ring 27.3X2.4
- 9 O-ring 27.3X2.4
- 10 Retainer ring 32/28.4x0.8(FPM)
- 11 O-ring with retainer ring must be input the hole before assemble the main spool core
- 12 Name plate
- 13 Pilot oil
- 15 Orifice hole
- 16 Assort depth

NS	D1	D2	D3	Code no. for main s	pool core assembly	Fixing screws	Torque(Nm)	Weight	
100		02	50	NBR	FPM	Tixing 3010w3	Torque(Min)	vvoignt	
10	10	40	10	360 727	360 728	4-M8 × 10-10.9			
25	20	45	20	360 729	306 730	GB/T70.1-2000	20	1.5kg	
32	30	45	30	300 729	300 730	GB/170.1-2000			

# **Notice** 1. The fluid must be filtered. Minimum filter fineness is 20 $\mu\text{m}.$ 2. The tank must be sealing up and an air filter must be installed on air entrance. 3. Products without subplate when leaving factory, if need them, please ordering specially. 4. Valve fixing screws must be high intensity level (class 10.9). Please select and use them according to the parameter listed in the sample book. 5. Roughness of surface linked with the valve is required to $\frac{0.8}{}$ . 6. Surface finish of mating piece is required to 0.01/100mm.